



Environmental Health & Safety

Oklahoma State University



FIRE SPRINKLER SYSTEM STANDARD

Environmental Health and Safety | University Health Services Suite 002 | Stillwater, OK 74078 | (405) 744-7241 | www.ehs.okstate.edu

Reviewed and Revised September 2018

Status

Contact(s)	Implementation Date	Comments
Gerald Petre, EHS	June 2016	Review and Update
Gerald Petre, EHS	September 2017	Review and Update
Gerald Petre, EHS	September 2018	Minor spacing updates.

General

Intent of Document

The information included in this section is intended to identify the SPECIFIC ITEMS required by Oklahoma State University in the design and construction of facilities on the campus. Items of "normal, code, industry or standard construction practice" are not included in this section.

Contractor Qualifications / Requirements

A minimum of five years specialized experience in sprinkler system installation is required. Project foremen shall have a minimum of three years of experience.

Shop drawings shall be submitted to Long Range Facilities Planning or Facilities Management. Long Range Facilities Planning or Facilities Management shall transmit the shop drawings to a representative of Environmental Health and Safety for approval prior to installation.

Design Criteria

Sprinkler systems shall be designed to a minimum category of "Ordinary Hazard I"; light hazard systems are not permitted in OSU buildings.

Materials

Above ground piping

All above ground piping shall be Schedule 40 black pipe without reducing bushings. No CPVC piping or fittings will be allowed.

Sprinklers

Sprinklers exposed to public view shall be chrome plated semi-recessed type - Star Sprinkler Corp. or approved equal.

Flexible sprinkler assemblies shall consist of wire braded hose only and shall be UL listed and FM approved. The flexible metal units are not authorized.

All sprinkler heads shall be installed in the center of ceiling tiles.

Spare Sprinkler Heads

Six spare sprinkler heads for each temperature and style used and a sprinkler wrench for each type head shall be provided inside a metal box installed adjacent to the main sprinkler valve in an accessible location not more than 5 1/2 feet above floor level. A list of sprinklers installed shall be posted in the sprinkler cabinet; list shall include manufacturer, model, orifice, deflector type thermal sensitivity, pressure rating, and identify in what area of the building each different sprinkler head was installed.

Valve Cabinets

Valve cabinets shall be Potter Roemer Series 1800, or approved equal, steel with white prime coat finish, fully recessed type, with wire glass door.

Hose Valves

Hose valves shall be Potter - Roemer, Elkhart Brass, or approved equal, single 2-1/2" polished chrome plated hose valve with 2-1/2" to 1-1/2" adapter with 1-1/2" cap and chain. The 2-1/2" valve and adapter shall be provided with National Standard Hose Threads. Turn outlet to corridor and cover any exposed pipe with chrome sleeve. A 1" minimum clearance between hand wheel and cabinet is required.

Flow Switches

The Flow switches shall be Potter Electric Signal Co. Model VSR series. **NO SUBSTITUTES.** All flow switches shall be set with a time delay between 45 and 60 seconds. Label all test valves with a sign that says "Test Valve - Keep Closed" in white letters on a red background. All test valves shall drain to the outside of the building unless otherwise approved by the Authority Having Jurisdiction (AHJ).

Exterior Fire Department Connection (FDC)

The FDC shall be a sidewall or flush mount wall type, installed 3' - 0" to 4' - 0" above exterior grade, and polished chrome plated, escutcheon plate with "Automatic Sprinklers" cast in plate, individual clappers on each inlet connection. Each inlet shall have female switch with pin lugs, National Standard Hose threads, gasket, and KNOX-type cap. Piping shall be pitched to automatic ball drop inside building or to approved exterior concrete valve pit with access cover.

There shall be a fire hydrant located within 150 feet of the FDC and shall be on the same side of the road as the FDC.

Locking Fire Department Connection Caps

A KNOX® locking cap shall be required on all fire department connections for water-based fire protection systems. All KNOX® caps shall be a bright stainless steel or polished chrome-like stainless steel finish. All KNOX® locking caps shall be keyed to the current Knox key wrenches for the local fire department having jurisdiction.

Control valves

All control valves shall be Stockholm, Traverse City, or approved equal, 175 lbs. test, crank type with butterfly valves, indicator, with tamper switch and lockable in the open position with a padlock.

Exterior Post Indicator Valve (PIV)

The PIV shall be Demco, Incorporated, or approved equal, painted with two coats of Rust-Oleum No. 1565, International Red, Quick Dry Gloss. **NO SUBSTITUTES.** PIV shall be installed so the top of the post is 32 in. to 40 in. above final grade.

The PIV Electrical Supervisory Switch

The PIV electrical supervisory switch shall be a Potter Electric Signal Co., Model PIVS- U. **NO SUBSTITUTES**, and the switch shall be installed on post indicator and control valves so that a supervisory signal will be registered on designated circuit of fire alarm system if valve is closed more than 1-1/2 turns from full open position. The switch shall be wired so when switch is in trouble position, it will not prevent sounding of fire alarm on circuit.

If the main sprinkler riser can be DIRECTLY accessed from the exterior of the building, the PIV may be eliminated with the AHJ's approval.

Water Flow Alarm

An electronic horn/strobe shall be installed on the exterior of the building above the FDC in a location approved by the AHJ.

Auxiliary / Inspectors Test Drains

All auxiliary and inspectors test drains shall be piped to the exterior of the building. **Hose bibs are not allowed.**

Installation and Acceptance

System shall be zoned into a minimum of two zones per floor with sectional valves, water flow switches, and tamper switches. Valves shall be capable of locking in open position. Exceptions shall be approved by the AHJ.

ALL CONTROL VALVES AND FLOW SWITCHES SHALL BE INSTALLED IN AN EASILY ACCESSIBLE LOCATION BETWEEN 4 AND 6 FEET ABOVE FINISHED FLOOR.

No sprinkler heads or sprinkler piping shall be installed in or routed through designated IT spaces.

Underground piping shall be inspected for compliance by representatives of Long Range Facilities Planning, Facilities Management and Environmental Health and Safety.

Underground piping shall be thoroughly flushed in accordance with NFPA 13 section 10.10.2.1, before piping is connected to building sprinkler system. Flushing shall be witnessed by representatives of Long Range Facilities Planning, Facilities Management and Environmental Health and Safety. Provide 48 hours prior notice.


Prior to placing piping in service, flush entire system as required, removing foreign substances. Continue flushing until water is clear, and check to ensure that debris has not clogged sprinklers. This flushing shall be witnessed by representatives of Long Range Facilities Planning, Facilities Management and Environmental Health and Safety. Provide 48 hours prior notice.

Test entire system hydrostatically at 200 psi or 50 psi over operating pressure for a period of two hours. (Prior partial tests will not be recognized for acceptance purposes.) Test shall be scheduled 48 hours in advance and shall be completed prior to pre-final inspection. Test shall be witnessed by representatives of Long Range Facilities Planning, Facilities Management and Environmental Health and Safety. Leaks shall be corrected and re-tests made until system is deemed acceptable. Record results on standard NFPA #13 test form. Three signed copies shall be furnished at time of testing.

Prior to pre-final inspection of system, contractor shall furnish two copies (one print and one PDF) of complete set of permanent plans showing entire system as installed. Plans shall show all pipe sizes, runs, valves, head temperatures, head counts, etc. and shall be made in a neat and legible manner suitable for use as permanent record for future maintenance of system. No acceptance or inspection will be made without plans. Pre-final test shall include testing of all water flow and tamper switches.

The installing contractor shall identify a hydraulically designed sprinkler system with an engraved or stamped metal sign secured with corrosion resistant wire, chain, or other approved means. Such signs shall be placed at the alarm valve, dry pipe valve, pre-action valve, or deluge valve supplying the corresponding hydraulically designed area; in accordance with NFPA 13.

NFPA 13 Fire Sprinkler Riser Detail

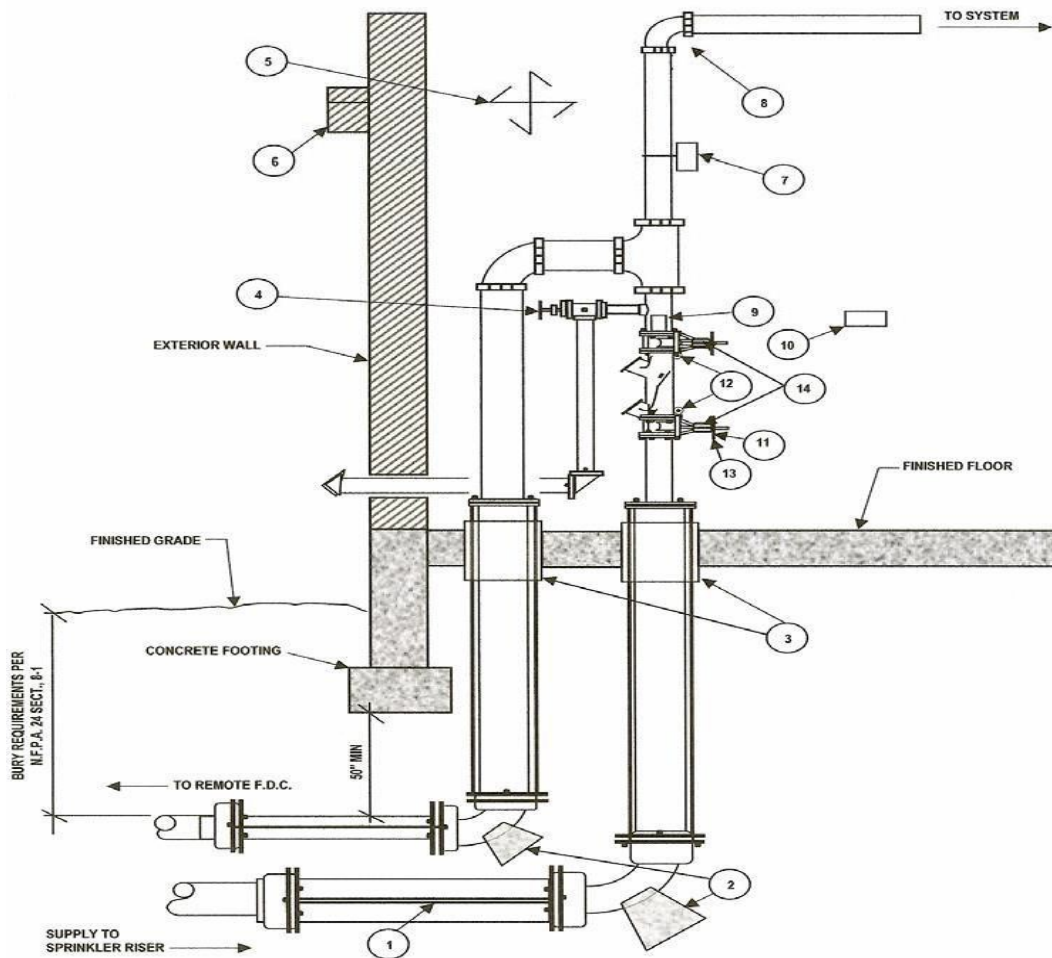

RISER KEY NOTES

- ① 5'- 0" DUCTILE IRON STUB-OUT FEED
- ② THRUST BLOCK
- ③ SLEEVE THRU FLOOR
- ④ 2" MAIN DRAIN WITH ANGLE VALVE
- ⑤ 4 - WAY SWAY BRACE
- ⑥ EXTERIOR HORN/STROBE
- ⑦ FLOW SWITCH
- ⑧ GROOVED ELBOW
- ⑨ HYDRAULIC DESIGN DATA PLATE
- ⑩ SPARE SPRINKLER BOX
- ⑪ DOUBLE CHECK VALVE ASSY
- ⑫ 300 PSI PRESSURE GAUGES
- ⑬ LISTED SYSTEM CONTROL VALVE WITH TAMPER
- ⑭ TAMPER SWITCH

NOTES:

- 1. FIRE SPRINKLER SYSTEM TO BE ELECTRONICALLY MONITORED BY U.L. OR F.M. LISTED CENTRAL STATION FOR FLOW, TAMPER AND TROUBLE.
- 2. PROVIDE A 3' - 0" CLEARANCE AROUND FIRE SPRINKLER RISER FOR MINIMUM ACCESS.
- 3. ALL VALVES SHALL BE A MAX. OF 6' - 0" A.F.F.